


SIDEWALK RAMP SECTION


NOTES:

1. FINISH: BROOM FINISH PERPENDICULAR TO TRAFFIC AND WITH PICTURE FRAME EDGES.
2. USE 4,400 PSI, CLASS F CONCRETE.
3. PROVIDE EXPANSION JOINT FILLER BETWEEN RAMP AND SIDEWALK.
4. DWS TO BE 24" WIDE AND RUN LENGTH OF FLUSH CONDITION ($\leq \frac{1}{4}$ " HEIGHT). MAX. 2" FRAME ALLOWED AT SIDES OF DWS.
5. RAMP SHALL CONFORM TO DETAIL ON CURRENT CTDOT CONCRETE SIDEWALK RAMP(S) GUIDE SHEETS

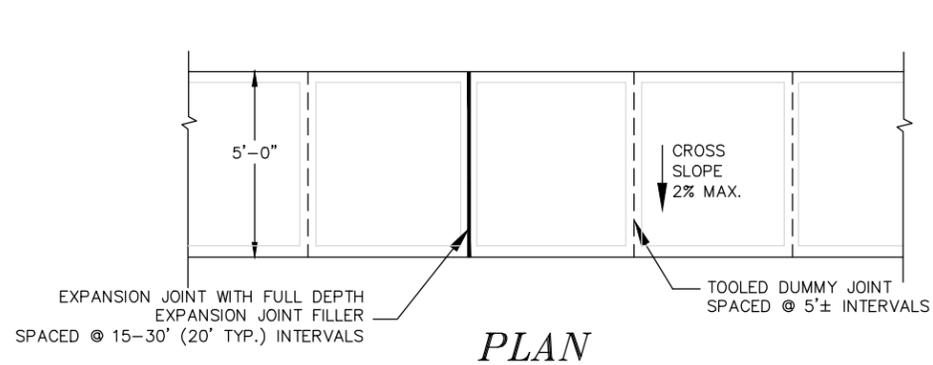


NOTES:

1. FINISH: BROOM FINISH PERPENDICULAR TO TRAFFIC AND WITH PICTURE FRAME EDGES.
2. USE 4,400 PSI, CLASS F CONCRETE.
3. CONCRETE REINFORCING IS NOT REQUIRED.

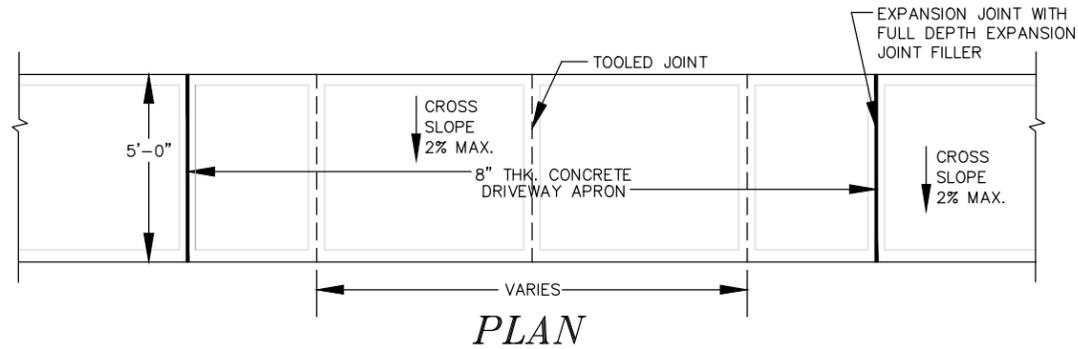


NOTES:

1. FINISH: BROOM FINISH PERPENDICULAR TO TRAFFIC AND WITH PICTURE FRAME EDGES.
2. RUN SIDEWALK CONTINUOUSLY THROUGH DRIVEWAY.
3. DRIVE TO BE 8" THICK WITH 6X6 - 10/10 WWF.
4. HAUNCH FRONT EDGE IF CONCRETE DRIVEWAY ABUTS ROAD.
5. USE 4,400 PSI, CLASS F CONCRETE.

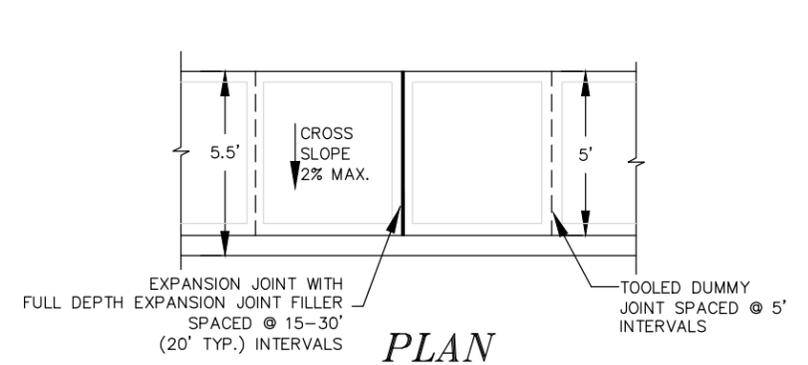


NOTES:


1. FINISH: BROOM FINISH WITH PICTURE FRAME EDGES.
2. USE 4,400 PSI, CLASS F CONCRETE.
3. CONCRETE REINFORCING IS NOT REQUIRED.

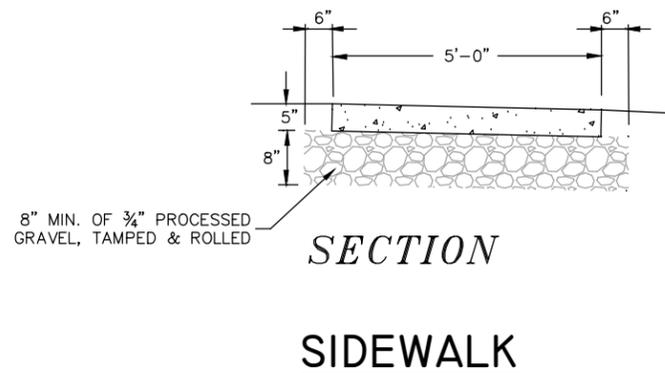

SIDEWALK

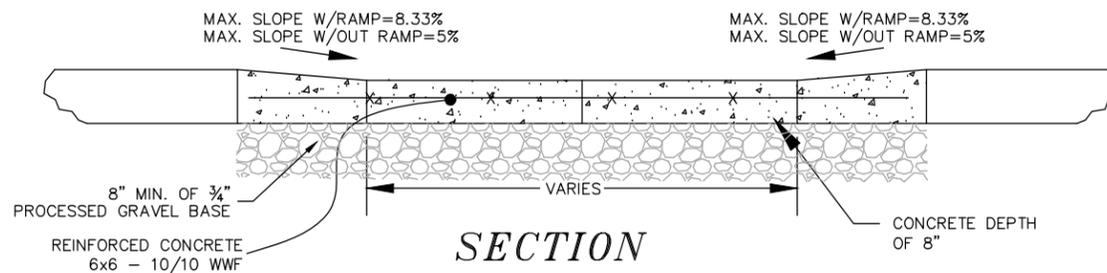

SIDEWALK THROUGH DRIVEWAY

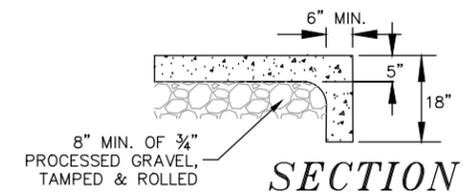

MONOLITHIC CURB SIDEWALK

SIDEWALK DETAILS FOR CONTRACTORS